STANDARD DETAIL NO. 9.25
LEE COUNTY UTILITIES
AIR GAP DETAIL

NOTE:

AIR GAP MUST HAVE A MINIMUM SEPARATION OF TWO TIMES THE INSIDE DIAMETER OF THE SUPPLY PIPE MEASURED VERTICALLY ABOVE THE TOP RIM OF THE VESSEL, WITH A MINIMUM DISTANCE OF THREE INCHES.

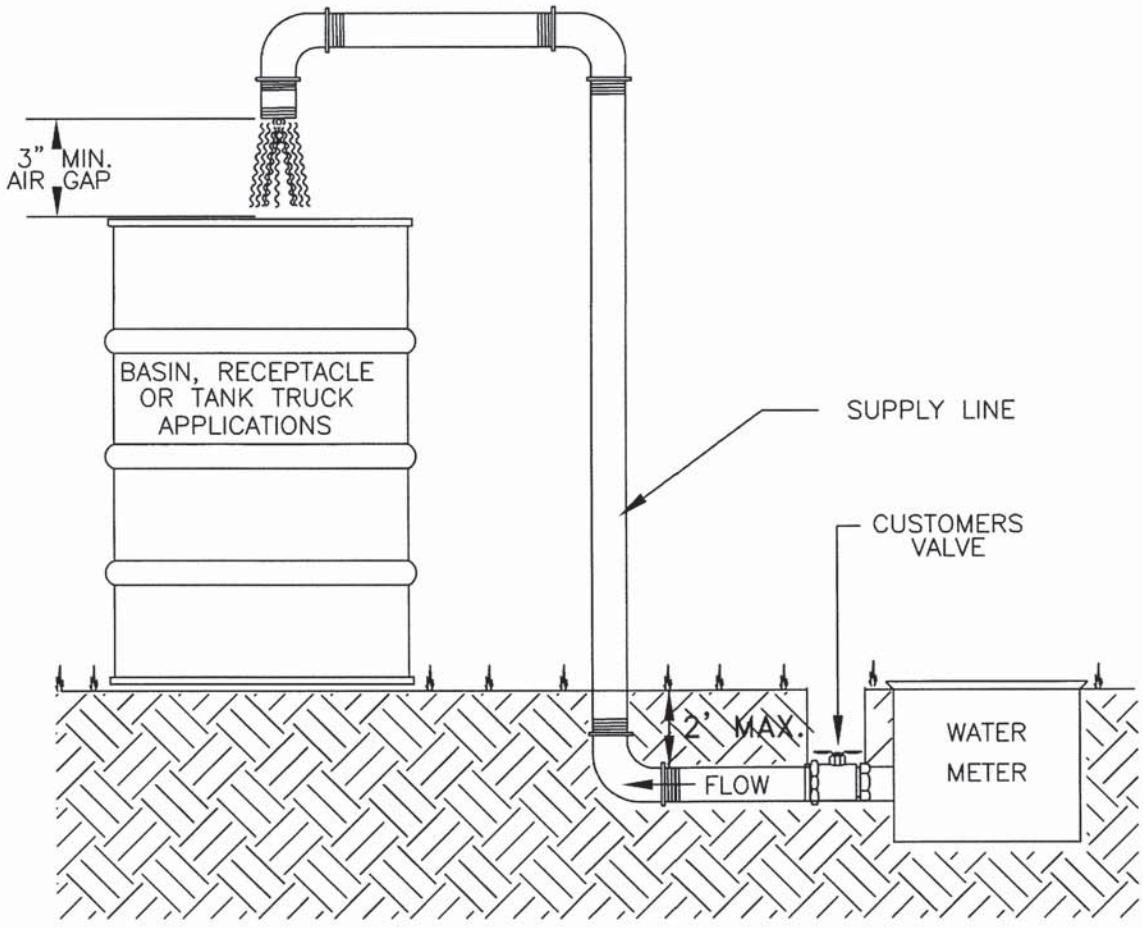

NTS

DATE: 02/22/00

S:\UTILS\ENGR\ACAD\DETAILS\25