


STANDARD DETAIL NO. 6.13

LEE COUNTY UTILITIES

WATER MAIN FLUSHING DETAIL

N.T.S.

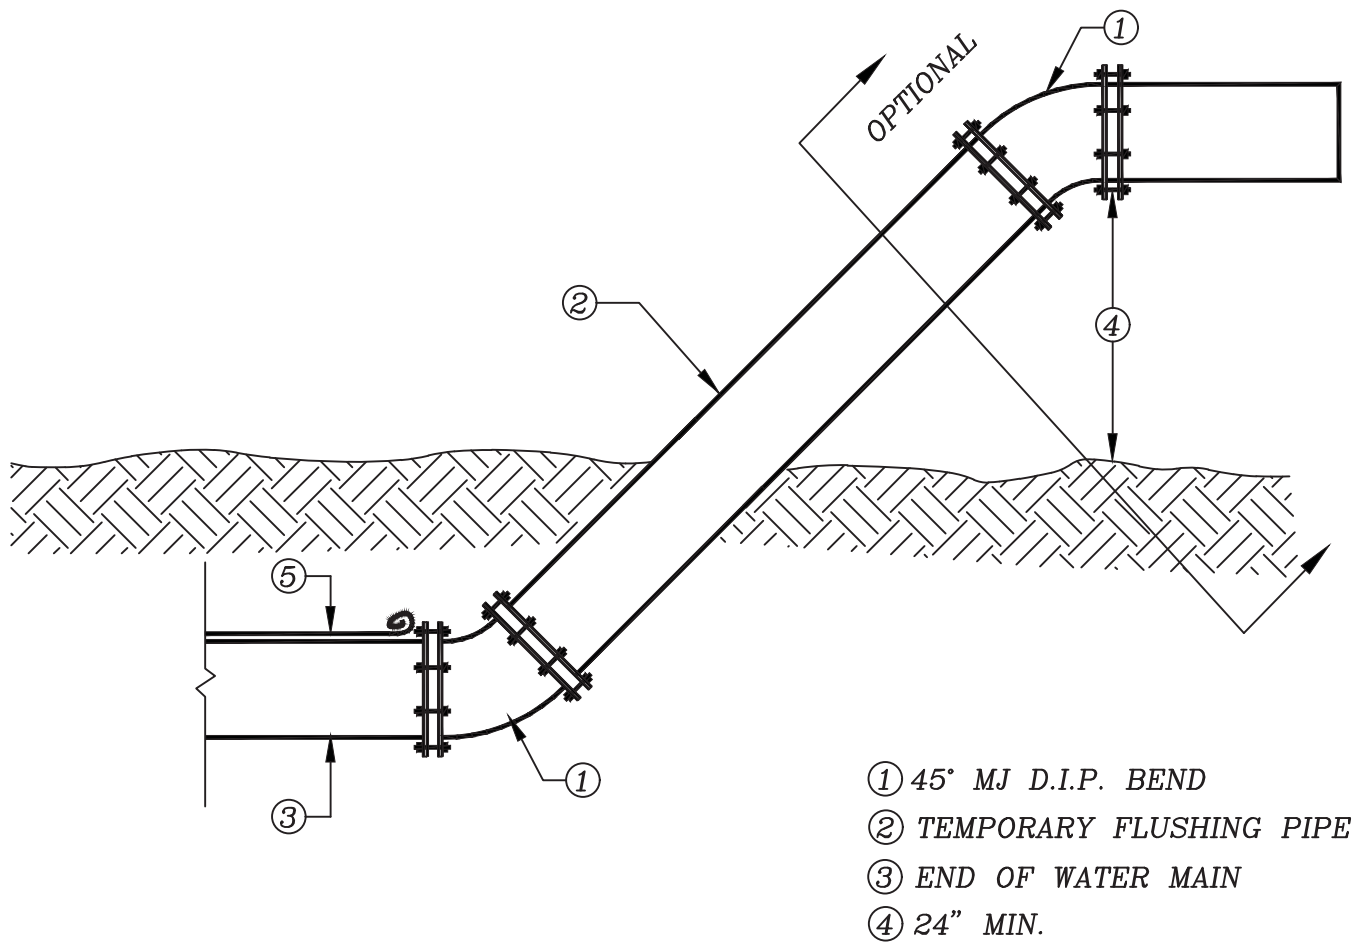

NOTES:

1. FLUSHING DETAIL TO BE USED ON WATER LINES 8" DIAMETER OR GREATER.
2. FLUSHING PIPE SHALL BE THE SAME DIAMETER AS WATER MAIN.
3. CONTRACTOR SHALL PROVIDE ADEQUATE DRAINAGE FOR FLUSHED WATER.
4. PROVIDE M.J. CAP IF ASSEMBLY IS LEFT IN PLACE UNATTENDED.
5. 12 GAUGE DOUBLE INSULATED COPPER LOCATING WIRE
(SEE LCU STANDARD DETAIL)