


ALL ABOVE GROUND PIPING AND FITTINGS TO BE 316 STAINLESS STEEL

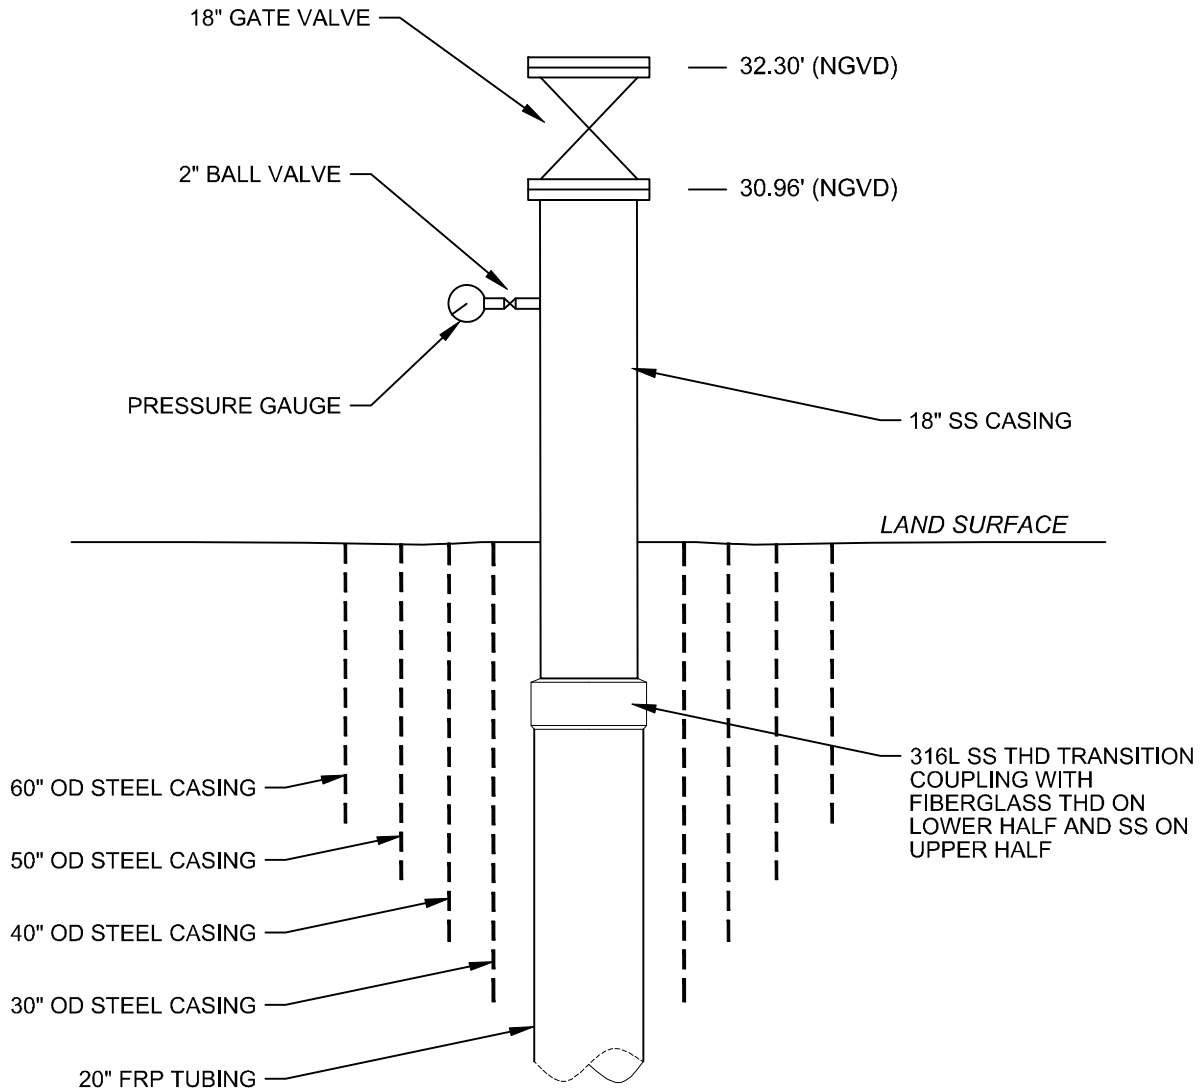

GATE VALVE

Gate valve shall be stainless steel with flanged ends, solid wedge gate, and outside screw and yoke. Valve shall be rated 300-pound SWP, 350-pound WOG and shall be Walworth, Crane, or equal.

NOT TO SCALE

FIGURE 5. WELLHEAD SCHEMATICS FOR INJECTION WELL IW-2.