


STANDARD DETAIL NO. 6.14

LEE COUNTY UTILITIES

BLOW OFF DETAIL

N.T.S.

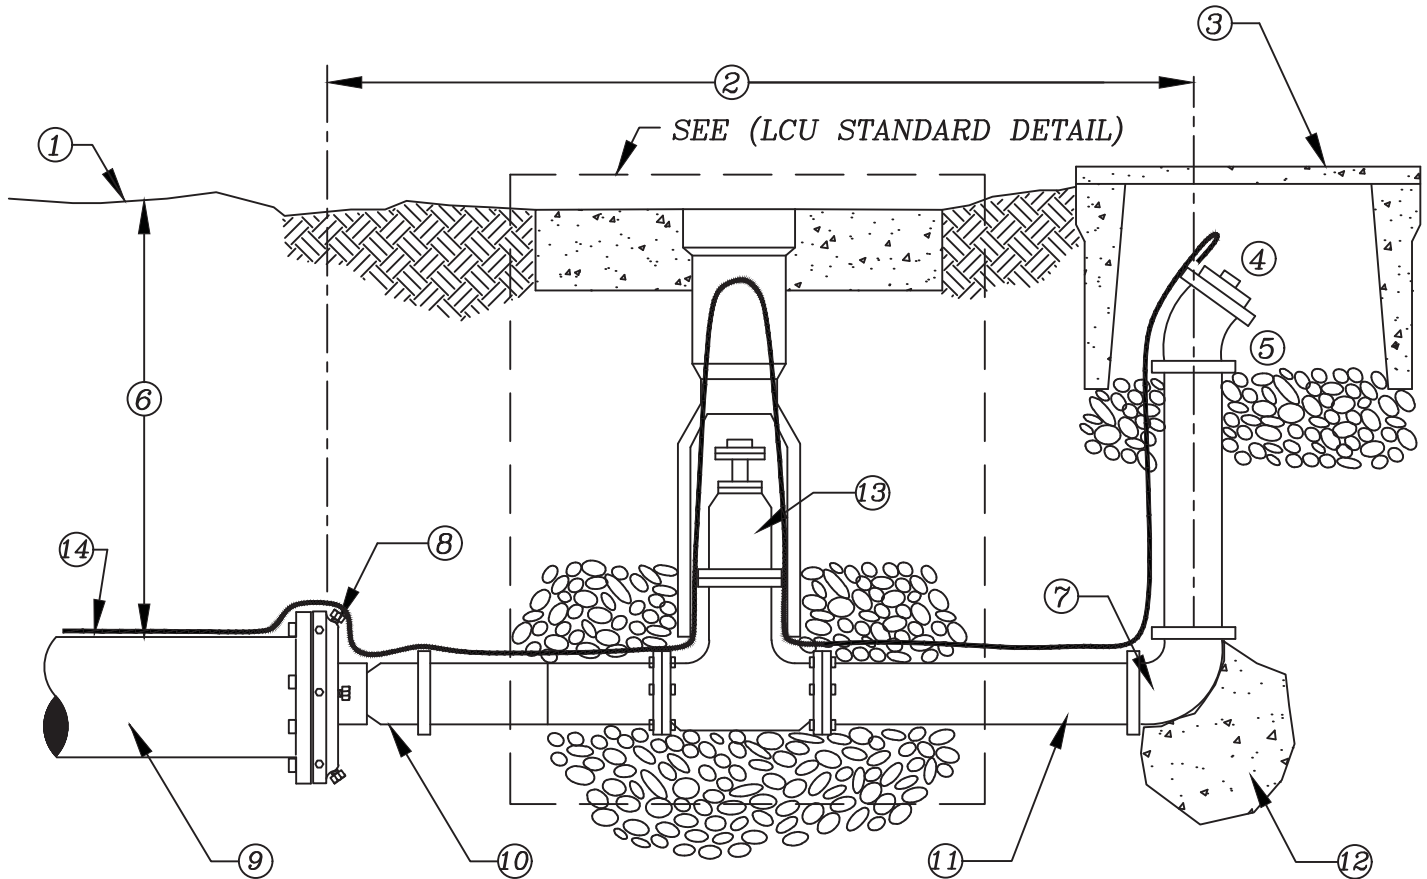

- | | |
|--|---|
| ① FINISHED GRADE | ⑦ 2" - 90° BEND |
| ② 5'-0" MAX. | ⑧ M.J. CAP WITH 2" TAP |
| ③ WATER METER BOX W/GRAVEL
BOTTOM (SEE APPROVED
MATERIAL LIST) | ⑨ END OF WATER MAIN, R.J. PER SCHEDULE |
| ④ 2" THREADED PLUG | ⑩ 2" THREADED |
| ⑤ 2" - 45° BEND | ⑪ 2" P.V.C. (SCH 80) MALE ADAPTER |
| ⑥ 30" MIN. | ⑫ POURED IN PLACE THRUST BLOCKING
(SEE DETAIL 9.20) |
| | ⑬ 2" DIAMETER GATE VALVE |
| | ⑭ 12 GAUGE DOUBLE INSULATED COPPER
LOCATING WIRE (SEE LCU STANDARD DETAIL) |

NOTE:

ALL PIPING TO BE 2" P.V.C. (SCH 80) THREADED FITTINGS
OR SOLVENT WELDED FITTINGS