


STANDARD DETAIL NO. 6.15

LEE COUNTY UTILITIES

TEMPORARY CONSTRUCTION JUMPER WITH METER

N.T.S.

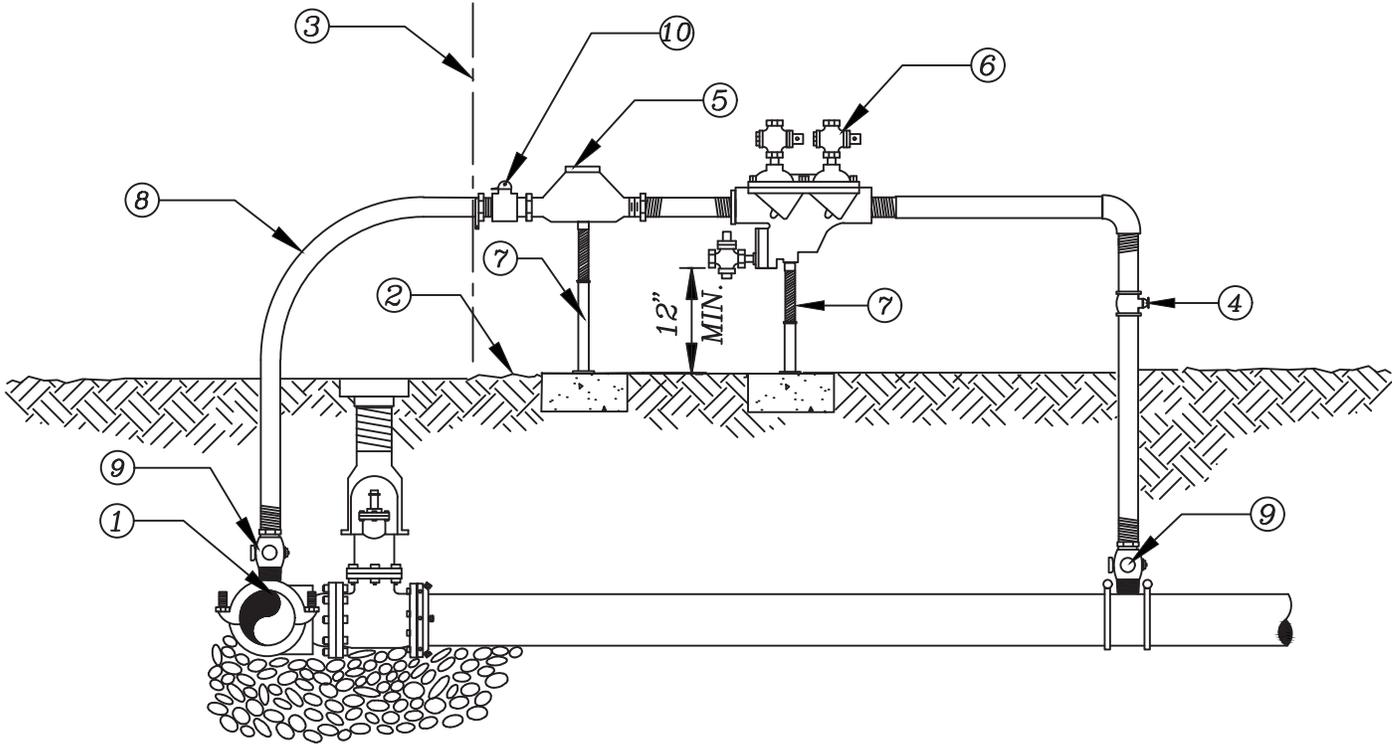

NOTES:

CONTRACTOR/CUSTOMER SHALL APPLY AT LEE COUNTY UTILITIES FOR TEMPORARY WATER SERVICE FIVE DAYS PRIOR TO REQUIRED SERVICE DATE. THE METER ONLY WILL BE FURNISHED BY LEE COUNTY UTILITIES. ALL FITTINGS, PIPING, VALVES AND MATERIALS SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR/CUSTOMER. THE APPROVED BACKFLOW PREVENTION DEVICE SHALL BE TESTED AND CERTIFIED BY LEE COUNTY UTILITIES APPROVED CERTIFIED BACKFLOW PREVENTION TECHNICIAN (FURNISHED BY CONTRACTOR/CUSTOMER) AT TIME OF METER INSTALLATION. CONTRACTOR/CUSTOMER SHALL PROTECT THE ASSEMBLY FROM DAMAGE. TEMPORARY CONSTRUCTION JUMPER/METER ASSEMBLY SHALL NOT BE REMOVED UNTIL SYSTEM IS ACCEPTED AND DEPARTMENT OF HEALTH CERTIFICATION AND CLEARANCE FOR SERVICE FORM HAS BEEN RECEIVED BY LEE COUNTY UTILITIES. WHEN THE NEW SYSTEM IS ACCEPTED, THE TEMPORARY CONSTRUCTION JUMPER METER ASSEMBLY MUST BE COMPLETELY REMOVED DOWN TO CORP STOPS.

- ① TAPPING SLEEVE AND VALVE TO BE FULLY RESTRAINED ON EXISTING MAIN (SEE LCU STANDARD DETAIL)
- ② GRADE
- ③ PROPERTY LINE AND/OR RIGHT OF WAY LINE
- ④ BRONZE BALL VALVE
- ⑤ METER FURNISHED BY LEE COUNTY UTILITIES
- ⑥ REDUCED PRESSURE BACKFLOW PREVENTER
- ⑦ PIPE STAND (SEE LCU STANDARD DETAIL)
- ⑧ 2" DIA. HDPE DR9
- ⑨ 2" DIA. CORPORATION STOP
- ⑩ 2" DIA. CURB STOP