


STANDARD DETAIL NO. 6.18

LEE COUNTY UTILITIES

5/8" THROUGH 2" SINGLE FAMILY RESIDENTIAL CROSS CONNECTION CONTROL ASSEMBLY

N.T.S.

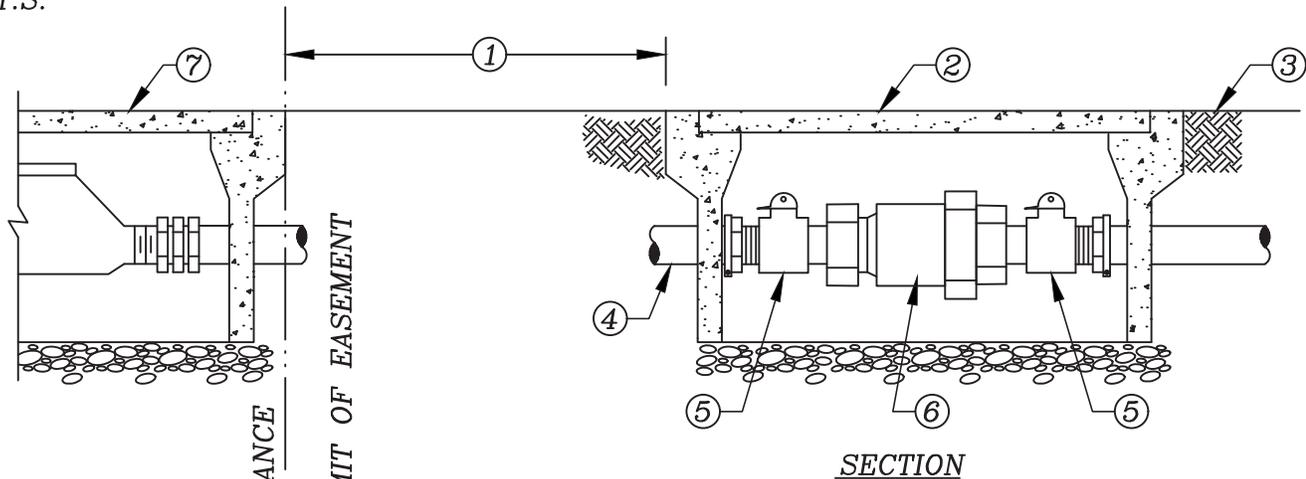

END OF LCU MAINTENANCE
 PROPERTY LINE
 RIGHT OF WAY OR LIMIT OF EASEMENT

- ① 1 FT. MINIMUM - 2 FT. MAXIMUM, LOCATED IN P.U.E.
- ② UTILITY BOX WITH COVER, TO BE LOCATED CLEAR OF DRIVEWAYS (SEE APPROVED MATERIAL LIST)
- ③ FINISHED GRADE
- ④ POLYETHYLENE TUBING, PE3408, 200 PSI SDR9, BLUE (SEE APPROVED MATERIAL LIST)
- ⑤ STRAIGHT CURB STOP (SEE APPROVED MATERIAL LIST)
- ⑥ L.C.U. APPROVED DUAL CHECK BACKFLOW PREVENTER (SEE APPROVED MATERIAL LIST)
- ⑦ WATER METER BOX

NOTE:

1. INITIAL DEVICE TESTING REQUIRED. REFURBISH OR REPLACE DUAL CHECK BACKFLOW PREVENTER AT LEAST EVERY 5 TO 10 YEARS.