


STANDARD DETAIL NO. 6.24

LEE COUNTY UTILITIES

FIRE HYDRANT ASSEMBLY

N.T.S.

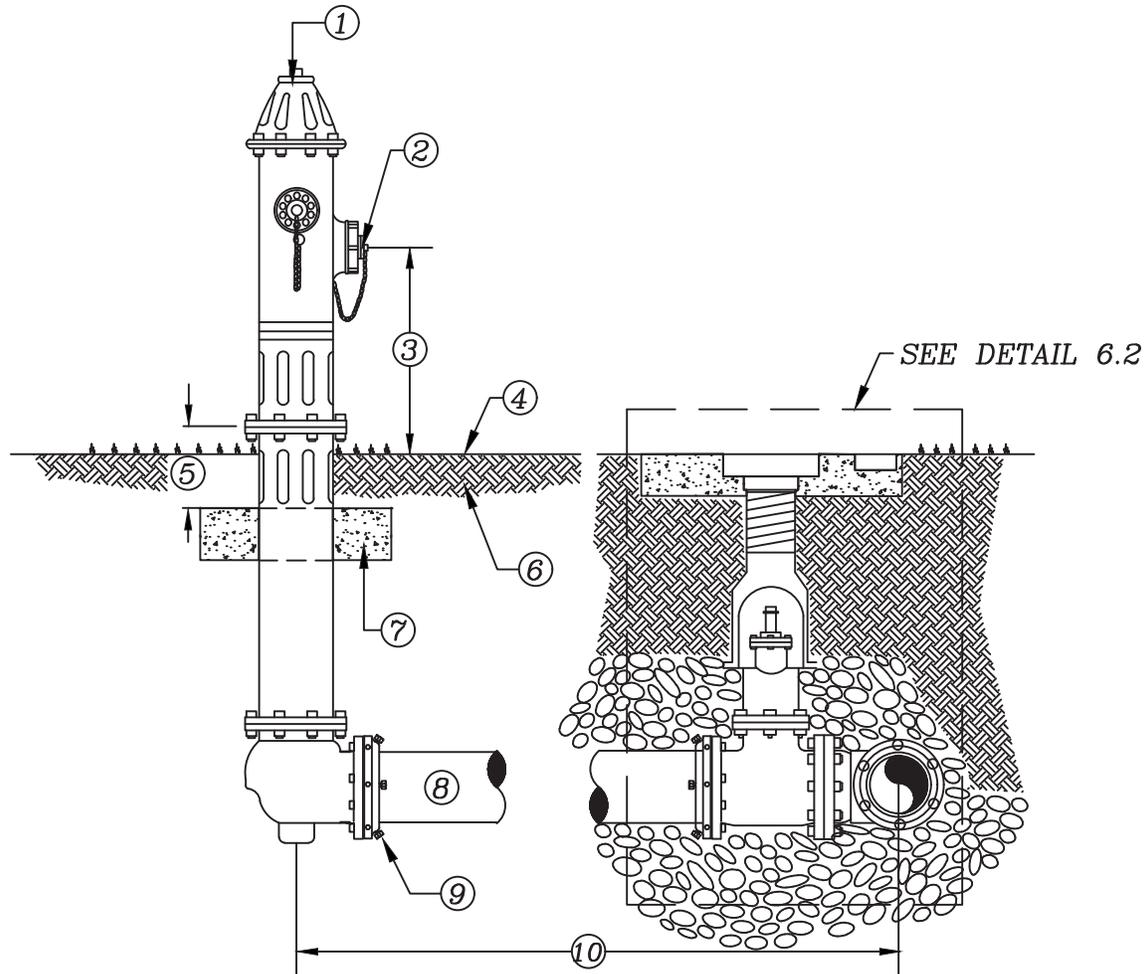

- | | |
|---|---|
| <p>① FIRE HYDRANT: STANDARD A.W.W.A. SAFETY YELLOW (SEE APPROVED MATERIAL LIST)</p> <p>② PUMPER CONNECTION FACING AS PER FIRE DISTRICT RECOMMENDATION</p> <p>③ 18" MIN. - 24" MAX.</p> <p>④ FINISHED GRADE</p> <p>⑤ 6" MIN. CLEARANCE</p> | <p>⑥ COMPACTED FILL</p> <p>⑦ 30" X 30" X 4" CONCRETE BREAK AWAY CONCRETE PAD, 3000 P.S.I.</p> <p>⑧ PIPE TO BE D.I.P., PRESSURE CLASS 350</p> <p>⑨ RESTRAINED JOINTS, FROM HYDRANT TO WATER MAIN</p> <p>⑩ VARIABLE DISTANCE, IF GREATER THAN 100' A VALVE SHALL BE INSTALLED AT HYDRANT BASE</p> |
|---|---|