


STANDARD DETAIL NO. 6.26

LEE COUNTY UTILITIES

PRESSURE VACUUM BREAKER

N.T.S.

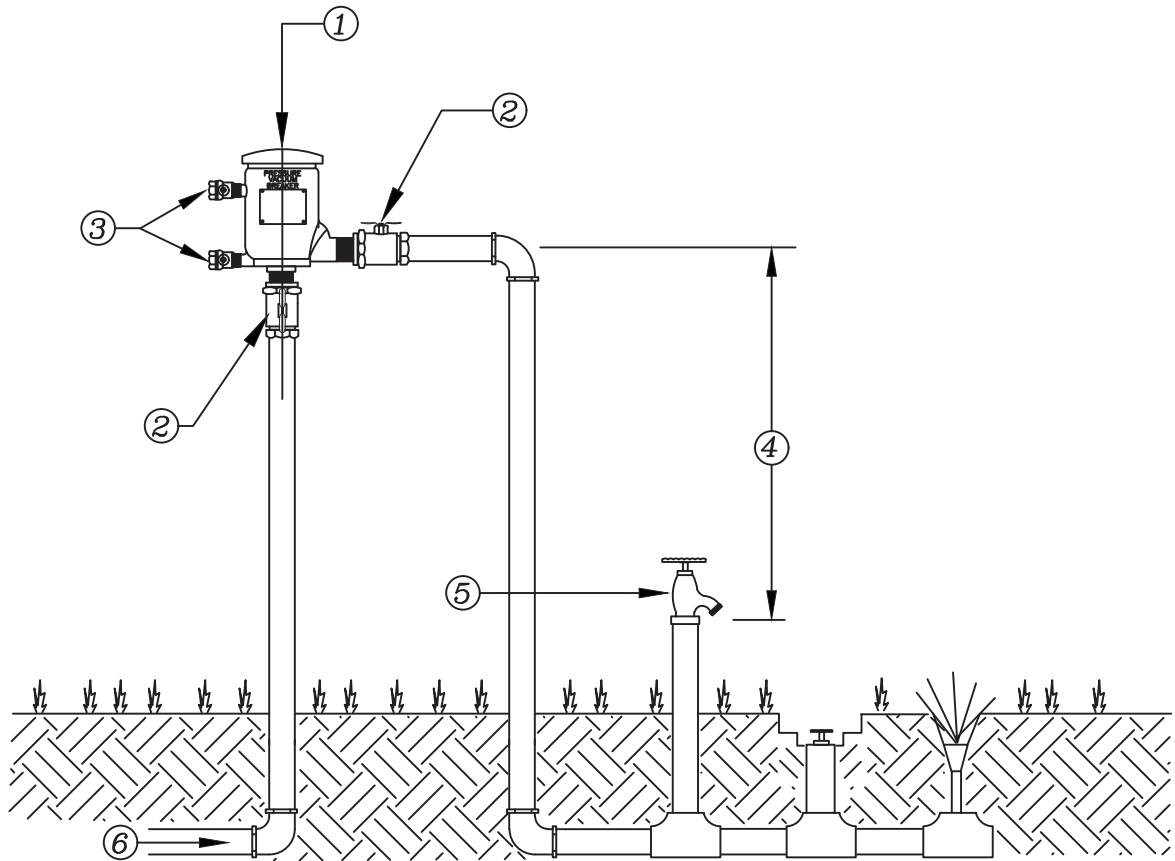

- ① PRESSURE VACUUM BREAKER TO BE USED ON IRRIGATION LINES ONLY
- ② RESILIENT SEATED FULL FLOW VALVE
- ③ TEST PORT
- ④ 12" MIN. ABOVE THE HIGHEST OUTLET
- ⑤ HOSE BIB
- ⑥ FLOW