


STANDARD DETAIL NO. 6.28

LEE COUNTY UTILITIES

MASTER PRECAST CONCRETE MANHOLE

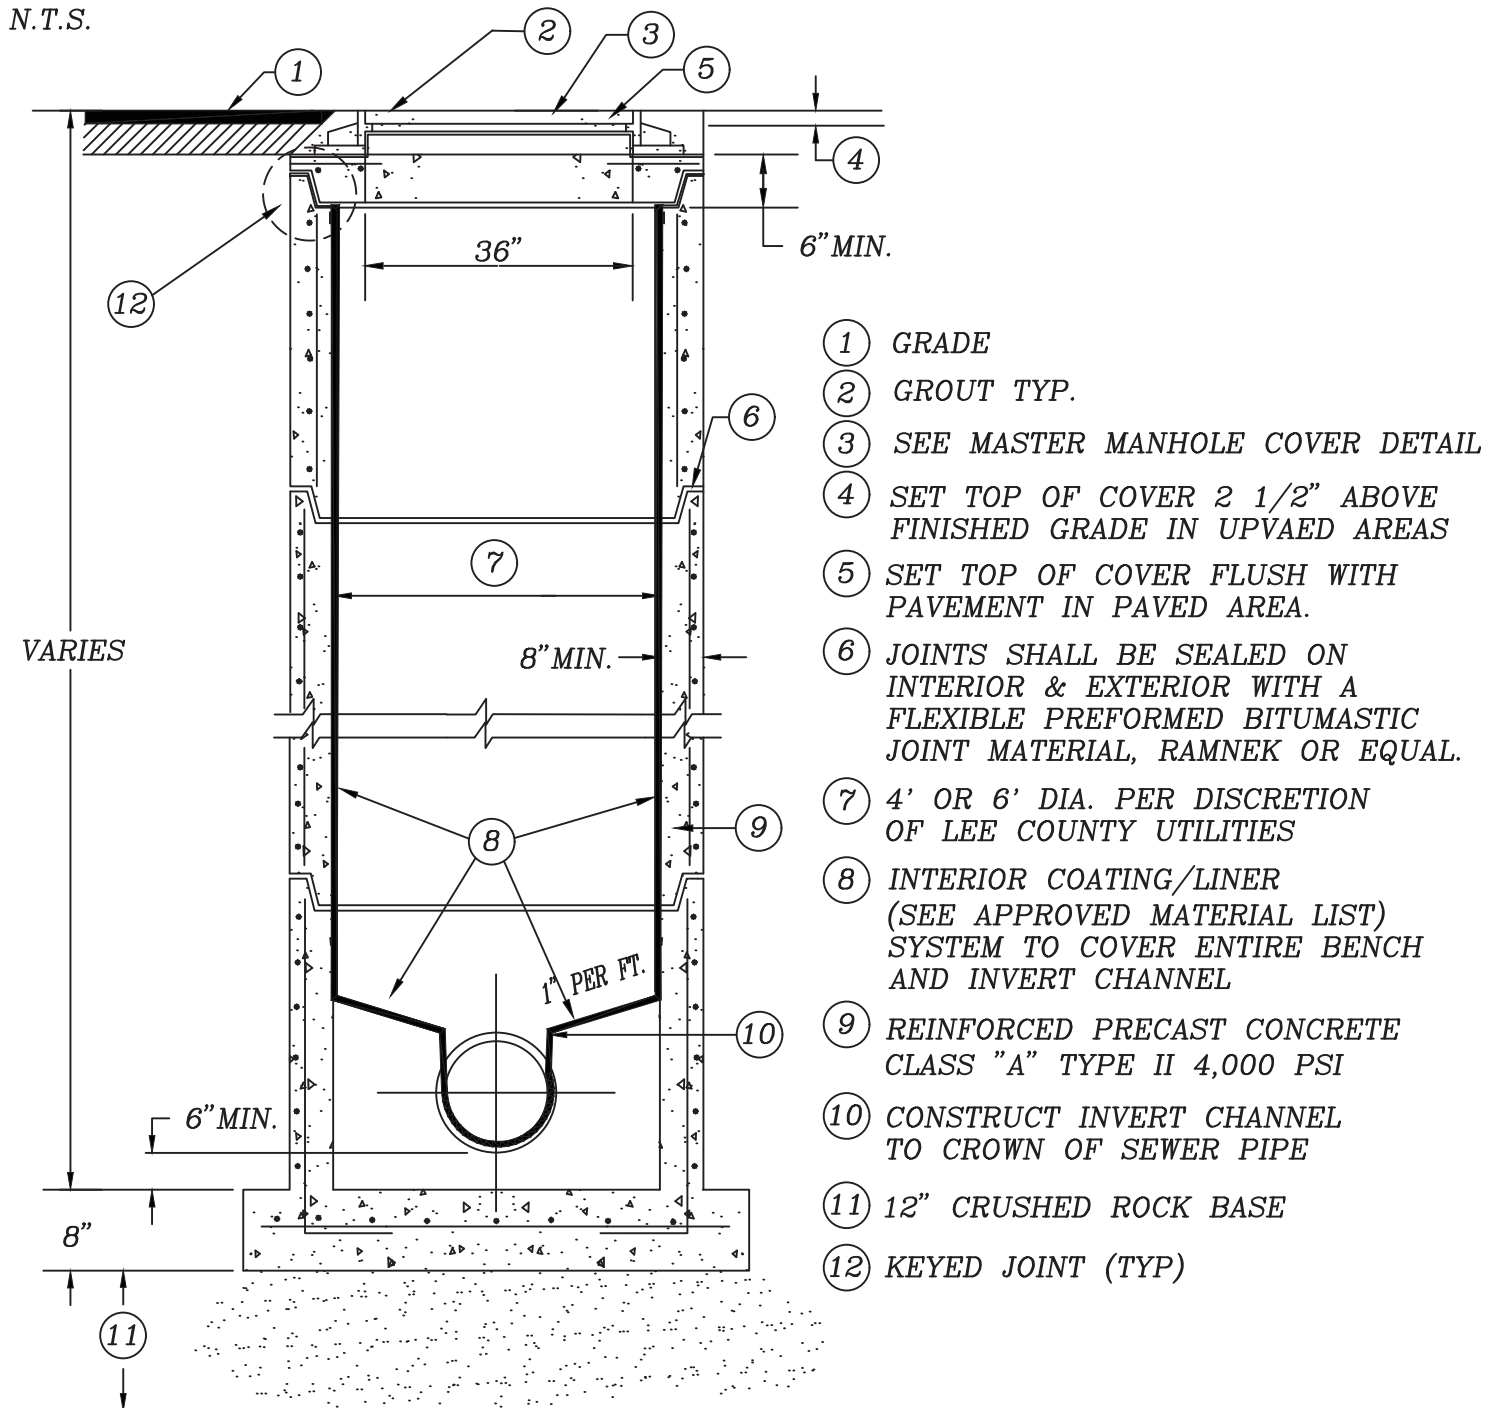

NOTES:

1. MASTER MANHOLES FOR WASTEWATER PUMPING STATIONS SHALL HAVE ONLY ONE INFLUENT AND ONE EFFLUENT PIPE, UNLESS OTHERWISE APPROVED BY LEE COUNTY UTILITIES.
2. FLEXIBLE, RESILIENT CONNECTIONS SHALL BE INSTALLED FOR ALL CONNECTIONS BETWEEN MANHOLE AND PIPES.