


STANDARD DETAIL NO. 6.37

LEE COUNTY UTILITIES


INSIDE MANHOLE DROP CONNECTION

N.T.S.

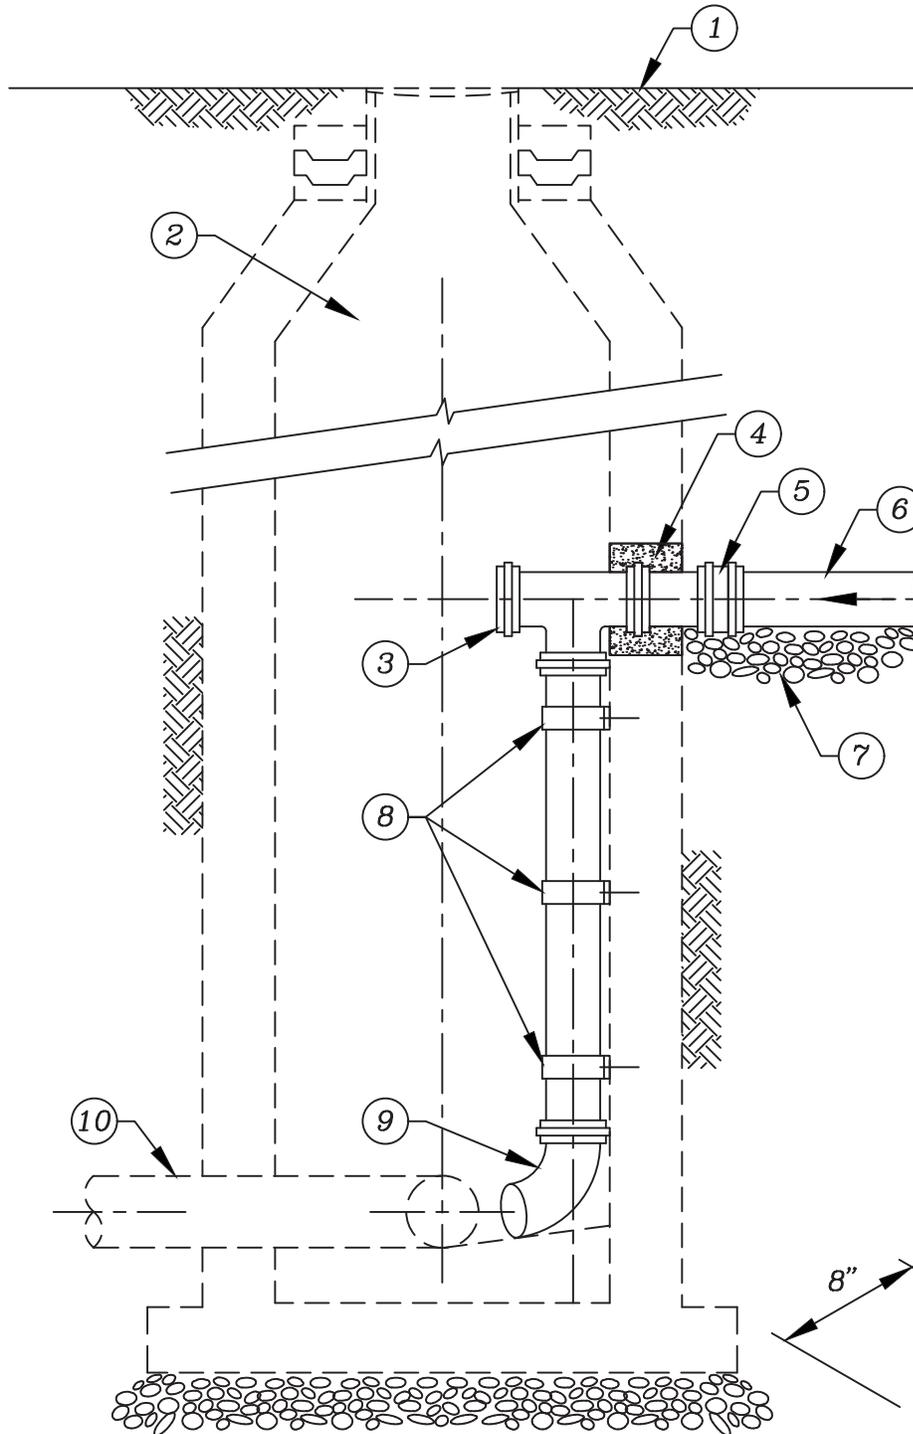

- ① EXISTING GRADE
- ② EXISTING MANHOLE
- ③ P.V.C. TEE
- ④ CORE DRILL MANHOLE AND FILL VOID WITH NON-SHRINK GROUT
- ⑤ COMPRESSION COUPLING
- ⑥ PVC SEWER
- ⑦ CRUSHED STONE BEDDING
- ⑧ STRAP AT TEE ELBOW AND ON 4' CENTERS WITH 1/2" ϕ EXPANSION TYPE S.S. CINCH BOLTS & S.S. ANCHORS
- ⑨ * 90° BEND RESTING ON RE-FORMED CHANNEL AND TURNED IN DIRECTION OF EXIST. SEWER FLOW
- ⑩ * EXIST. SEWER

* PIPE SIZE VARIES

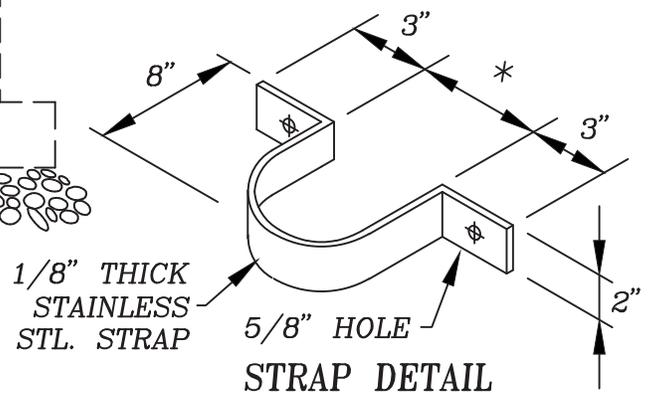

NOTE:
THE CONSTRUCTION OF AN INSIDE DROP MANHOLE IS ONLY PERMITTED WITH PRIOR APPROVAL OF THE AUTHORITY.