


# STANDARD DETAIL NO. 6.6

## LEE COUNTY UTILITIES

### JACK AND BORE

N.T.S.

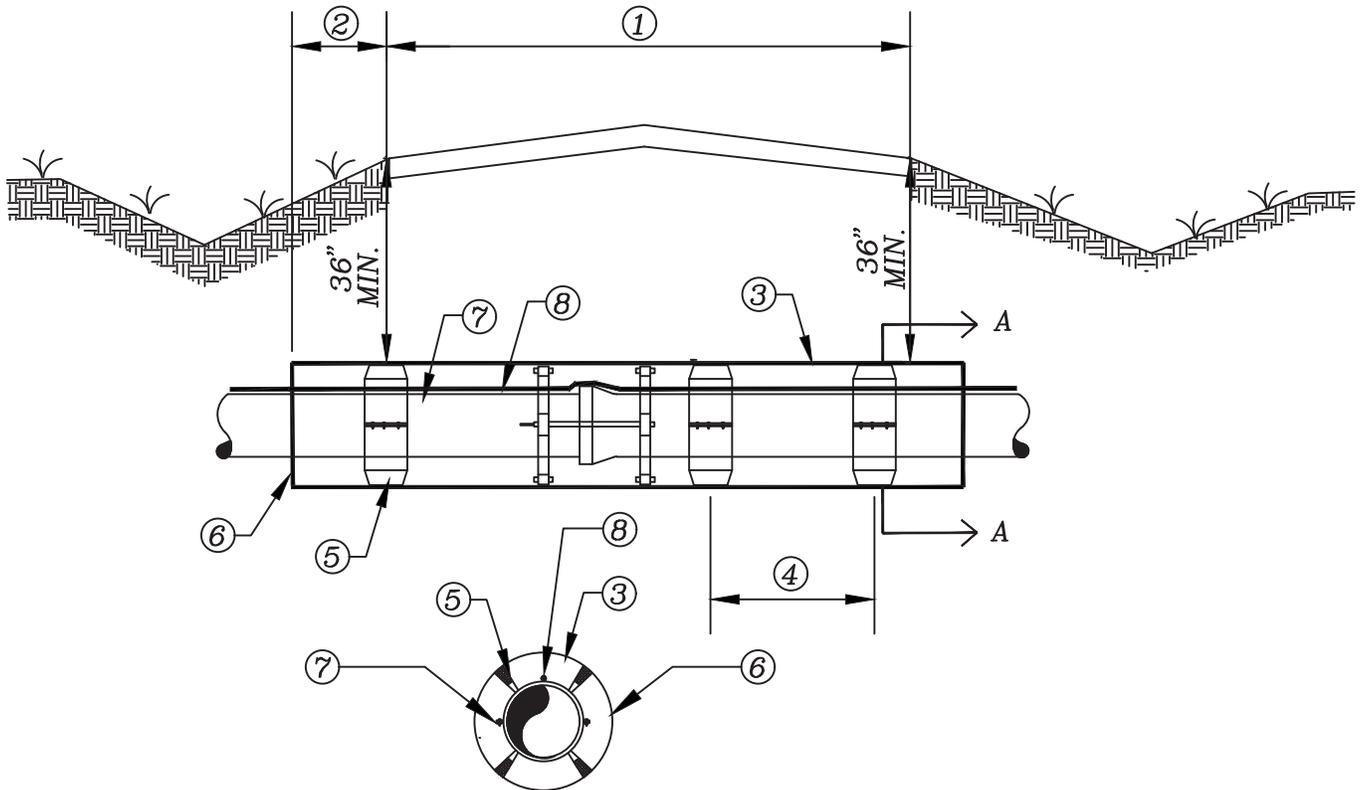

SECTION "A-A"

- ① LIMITS OF PAVEMENT
- ② EXTEND CASING 4' MIN. BEYOND E.O.P. AND/OR BACK OF CURB FOR L.C.D.O.T. MAINTAINED R.O.W. AND 8' MIN. FOR F.D.O.T. MAINTAINED R.O.W.
- ③ STEEL CASING PIPE CONFORMING TO ASTM A-139
- ④ 7'O.C. MAX OR AS PER MANUFACTURER'S RECOMMENDATION
- ⑤ L.C.U. APPROVED CASING SPACERS
- ⑥ SEAL CASING ENDS WITH:  
8" WALL OF BRICK MASONRY WITH WEEP HOLE INSTALLED NEAR BOTTOM, OR APPROVED EQUAL
- ⑦ ALL JOINTS OF THE CARRIER PIPE SHALL HAVE BELL RESTRAINTS
- ⑧ 12 GAUGE DOUBLE INSULATED COPPER WIRE (SEE LCU STANDARD DETAIL)